



**FILTRAZIONE GROSSOLANA coarse 70% secondo EN ISO 16890 (Classe G4 secondo EN779:2012\*)**  
**COARSE FILTRATION coarse 70% according to EN ISO 16890 (Class G4 according to EN779:2012\*)**

**CELLE FILTRANTI PIEGHETTATE**  
**PLEATED FILTER CELLS**

**WS2**



**CARATTERISTICHE GENERALI**

I WS2 sono filtri con struttura a cella costituiti da un pacco filtrante pieghettato in poliestere autoportante completamente sigillato in un telaio in cartone fustellato resistente all'umidità.

**GENERAL SPECIFICATIONS**

*WS2 are cell-structure filters made of a pleated self-supporting polyester filter pack completely sealed in a frame in punched moisture-resistant cardboard.*

**APPLICAZIONI**

- Prefiltrazione per aria condizionata
- Apparecchiature e/o sistemi di ventilazione
- Altamente efficace con polvere grossolana.

**APPLICATIONS**

- Prefiltration for air-conditioning
- Ventilation equipment and/or systems
- Highly effective with coarse dust.

**Caratteristiche tecniche – Technical data**

<b>Media filtrante:</b> <b>Filter medium:</b>	Poliestere Polyester
<b>Materiale telaio:</b> <b>Frame material:</b>	Cartone fustellato Punched cardboard
<b>Classificazione [EN ISO 16890]:</b> <b>Classification [EN ISO 16890]:</b>	Coarse 70%
<b>Classificazione [EN 779:2012*]:</b> <b>Classification [EN 779:2012*]:</b>	G4
<b>ΔP iniziale:</b> <b>Initial ΔP:</b>	75 Pa
<b>ΔP finale max:</b> <b>Max final ΔP:</b>	200 Pa
<b>Completamente inceneribile:</b> <b>Completely incenerable:</b>	Si Yes
<b>Rigenerabilità:</b> <b>Regeneration:</b>	No No

\*Ritirata e sostituita da EN ISO 16890

\*Withdrawn and superseded by EN ISO 16890




**FILTRAZIONE GROSSOLANA coarse 70% secondo EN ISO 16890 (Classe G4 secondo EN779:2012\*)**  
**COARSE FILTRATION coarse 70% according to EN ISO 16890 (Class G4 according to EN779:2012\*)**

CELLE FILTRANTI PIEGHETTATE  
PLEATED FILTER CELLS

WS2

Condizioni di esercizio - Working conditions	
Temperatura massima di esercizio: Max working temperature:	80°C
U.R max di esercizio Max working R.H.	100%

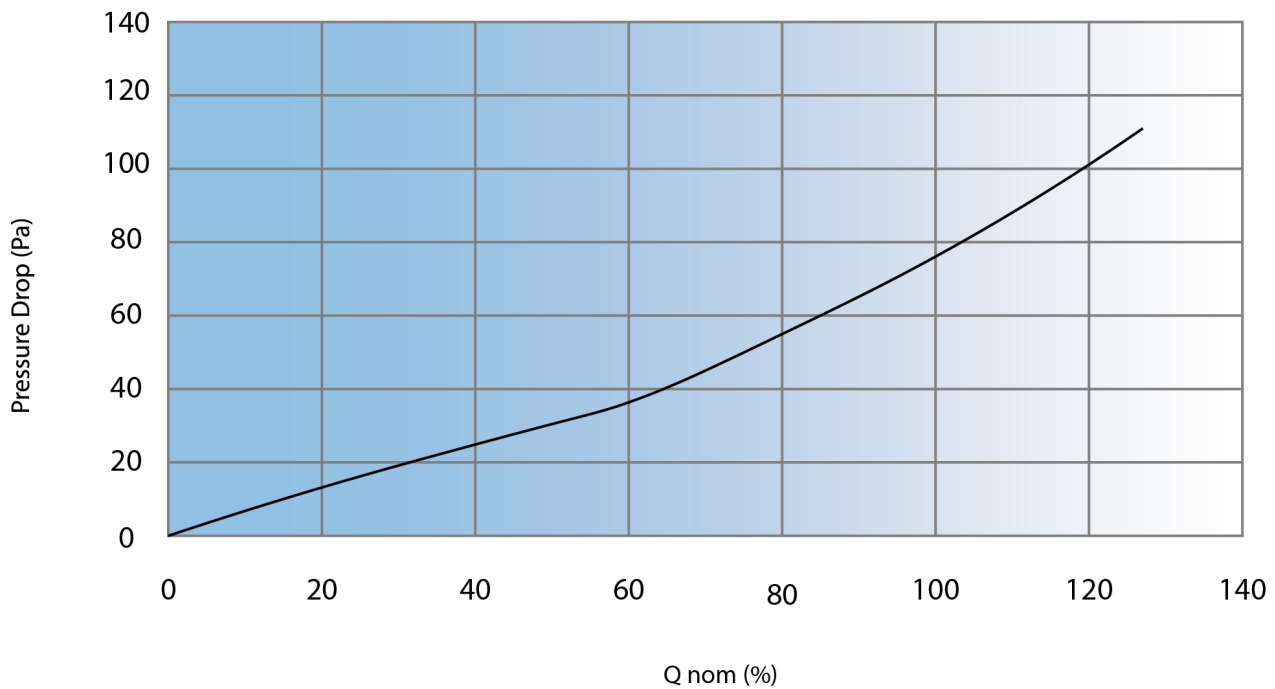



**FILTRAZIONE GROSSOLANA coarse 70% secondo EN ISO 16890 (Classe G4 secondo EN779:2012\*)**  
**COARSE FILTRATION coarse 70% according to EN ISO 16890 (Class G4 according to EN779:2012\*)**

CELLE FILTRANTI PIEGHETTATE  
PLEATED FILTER CELLS

WS2

Dimensioni Dimensions (mm)	Portata Air flow (m <sup>3</sup> /h)	Superficie filtrante Filter surface (m <sup>2</sup> )	ΔP (Pa)
287X592X95	1850	0,88	75
394X394X95	1680	0,82	75
394X494X95	2100	1,03	75
394X621X95	2650	1,32	75
494X494X95	2640	1,27	75
494X621X95	3330	1,58	75
592X592X95	3800	1,83	75
287X592X47	1650	0,42	75
394X394X47	1500	0,4	75
394X494X47	1890	0,5	75
394X621X47	2380	0,63	75
494X494X47	2370	0,6	75
494X621X47	2980	0,76	75
592X592X47	3400	0,87	75